
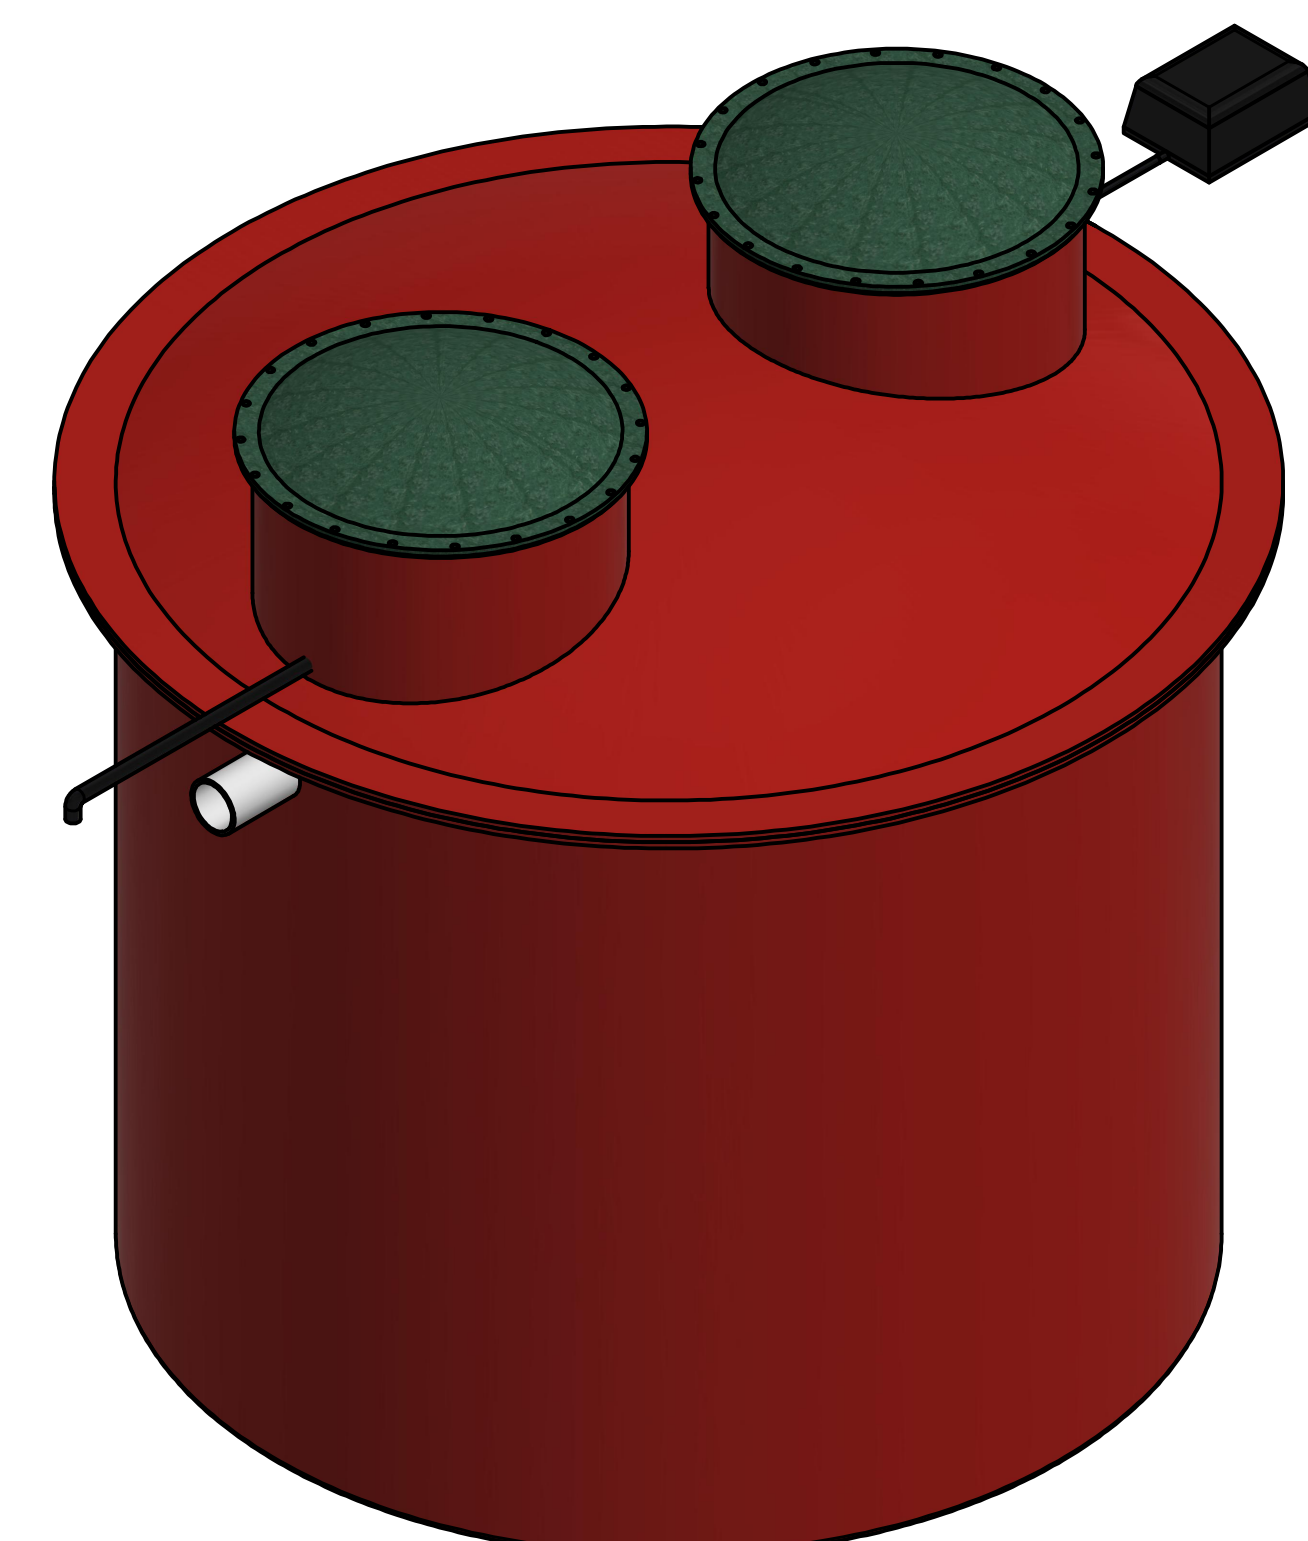
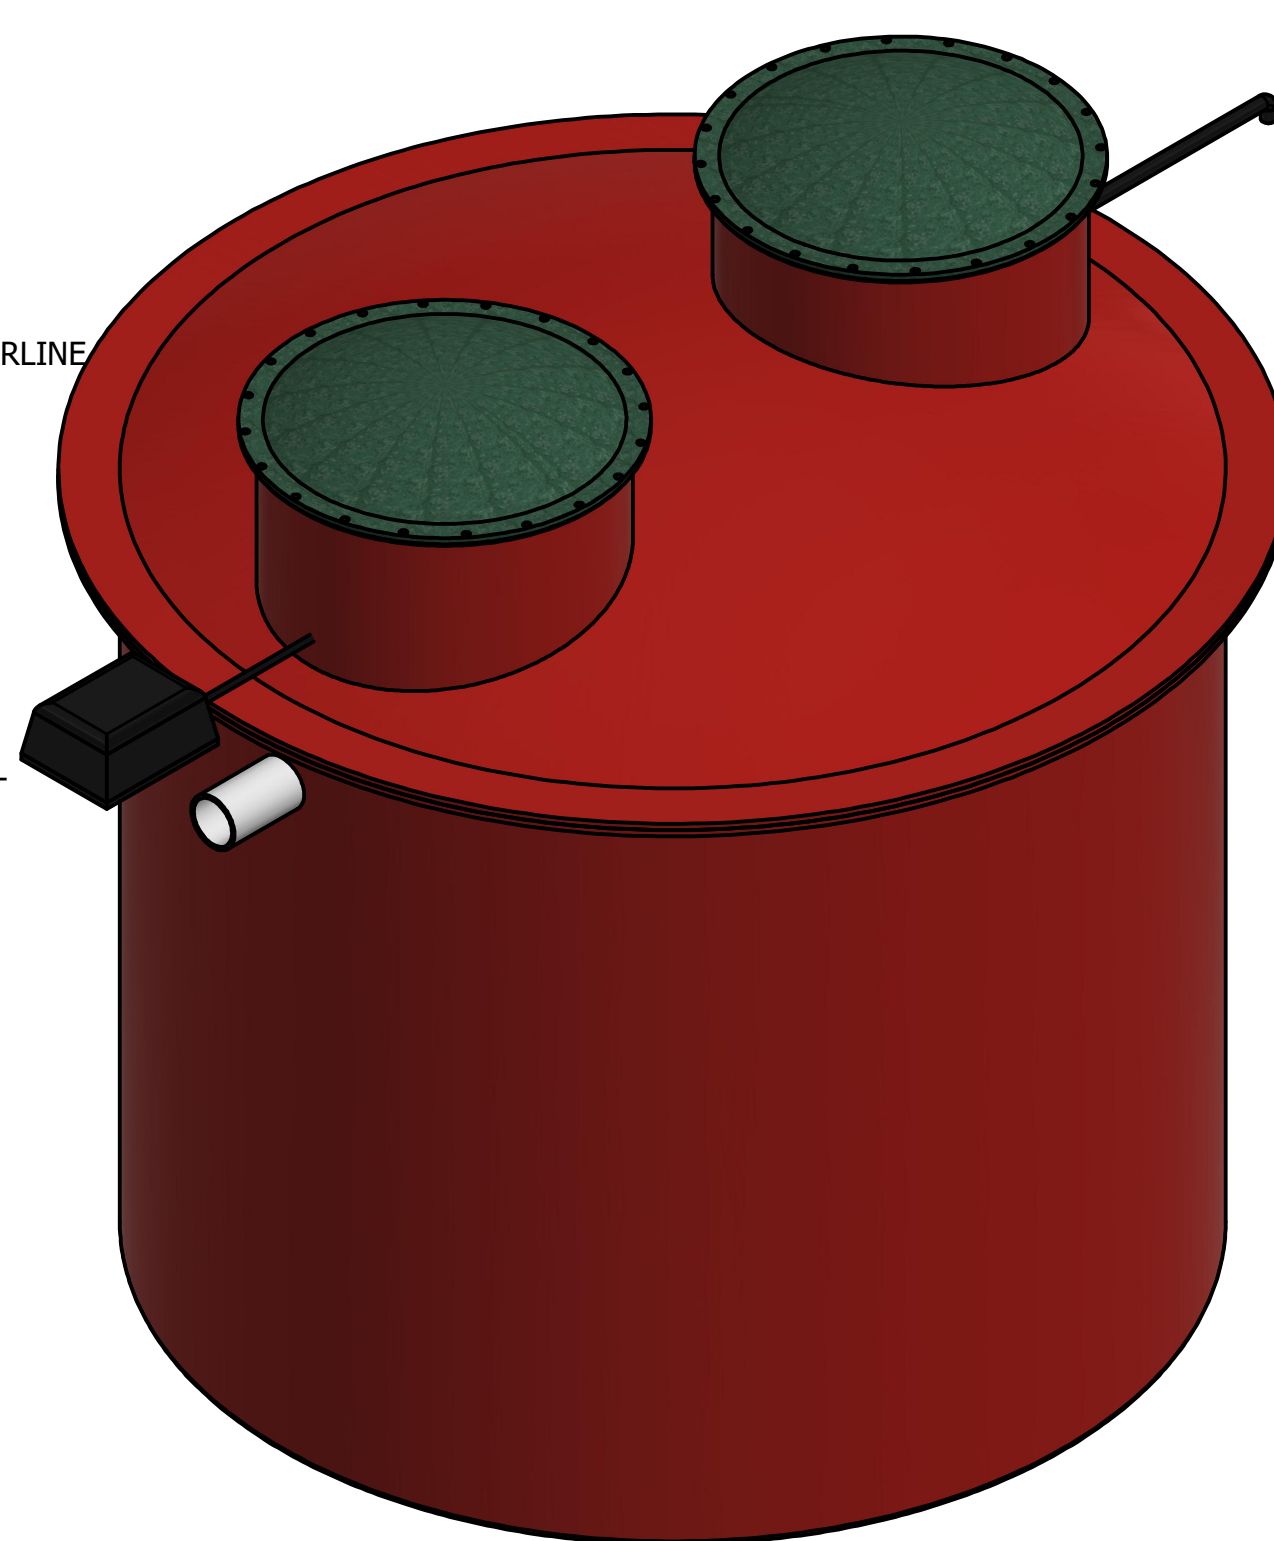
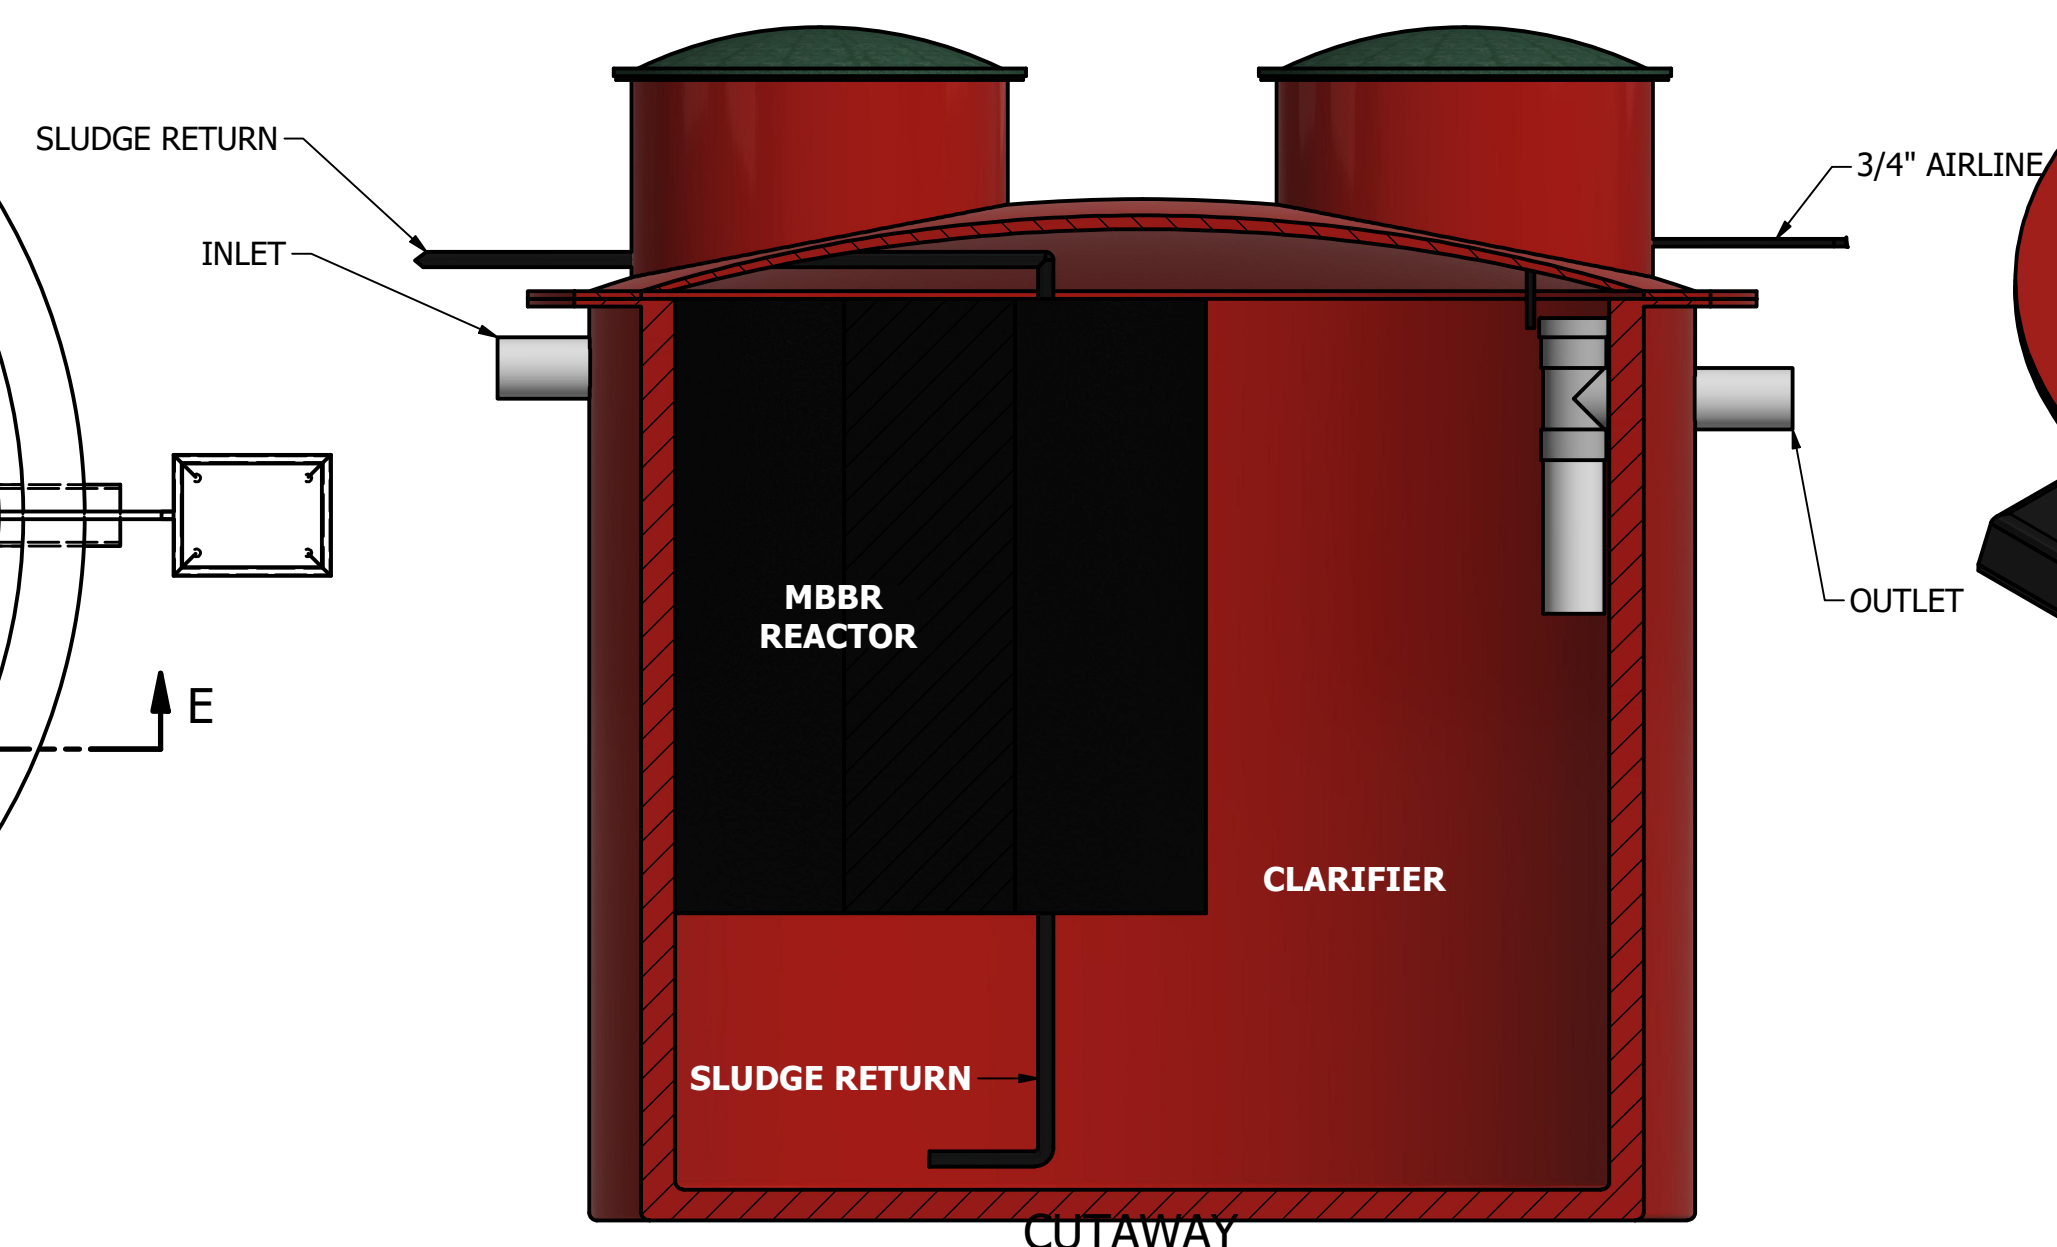
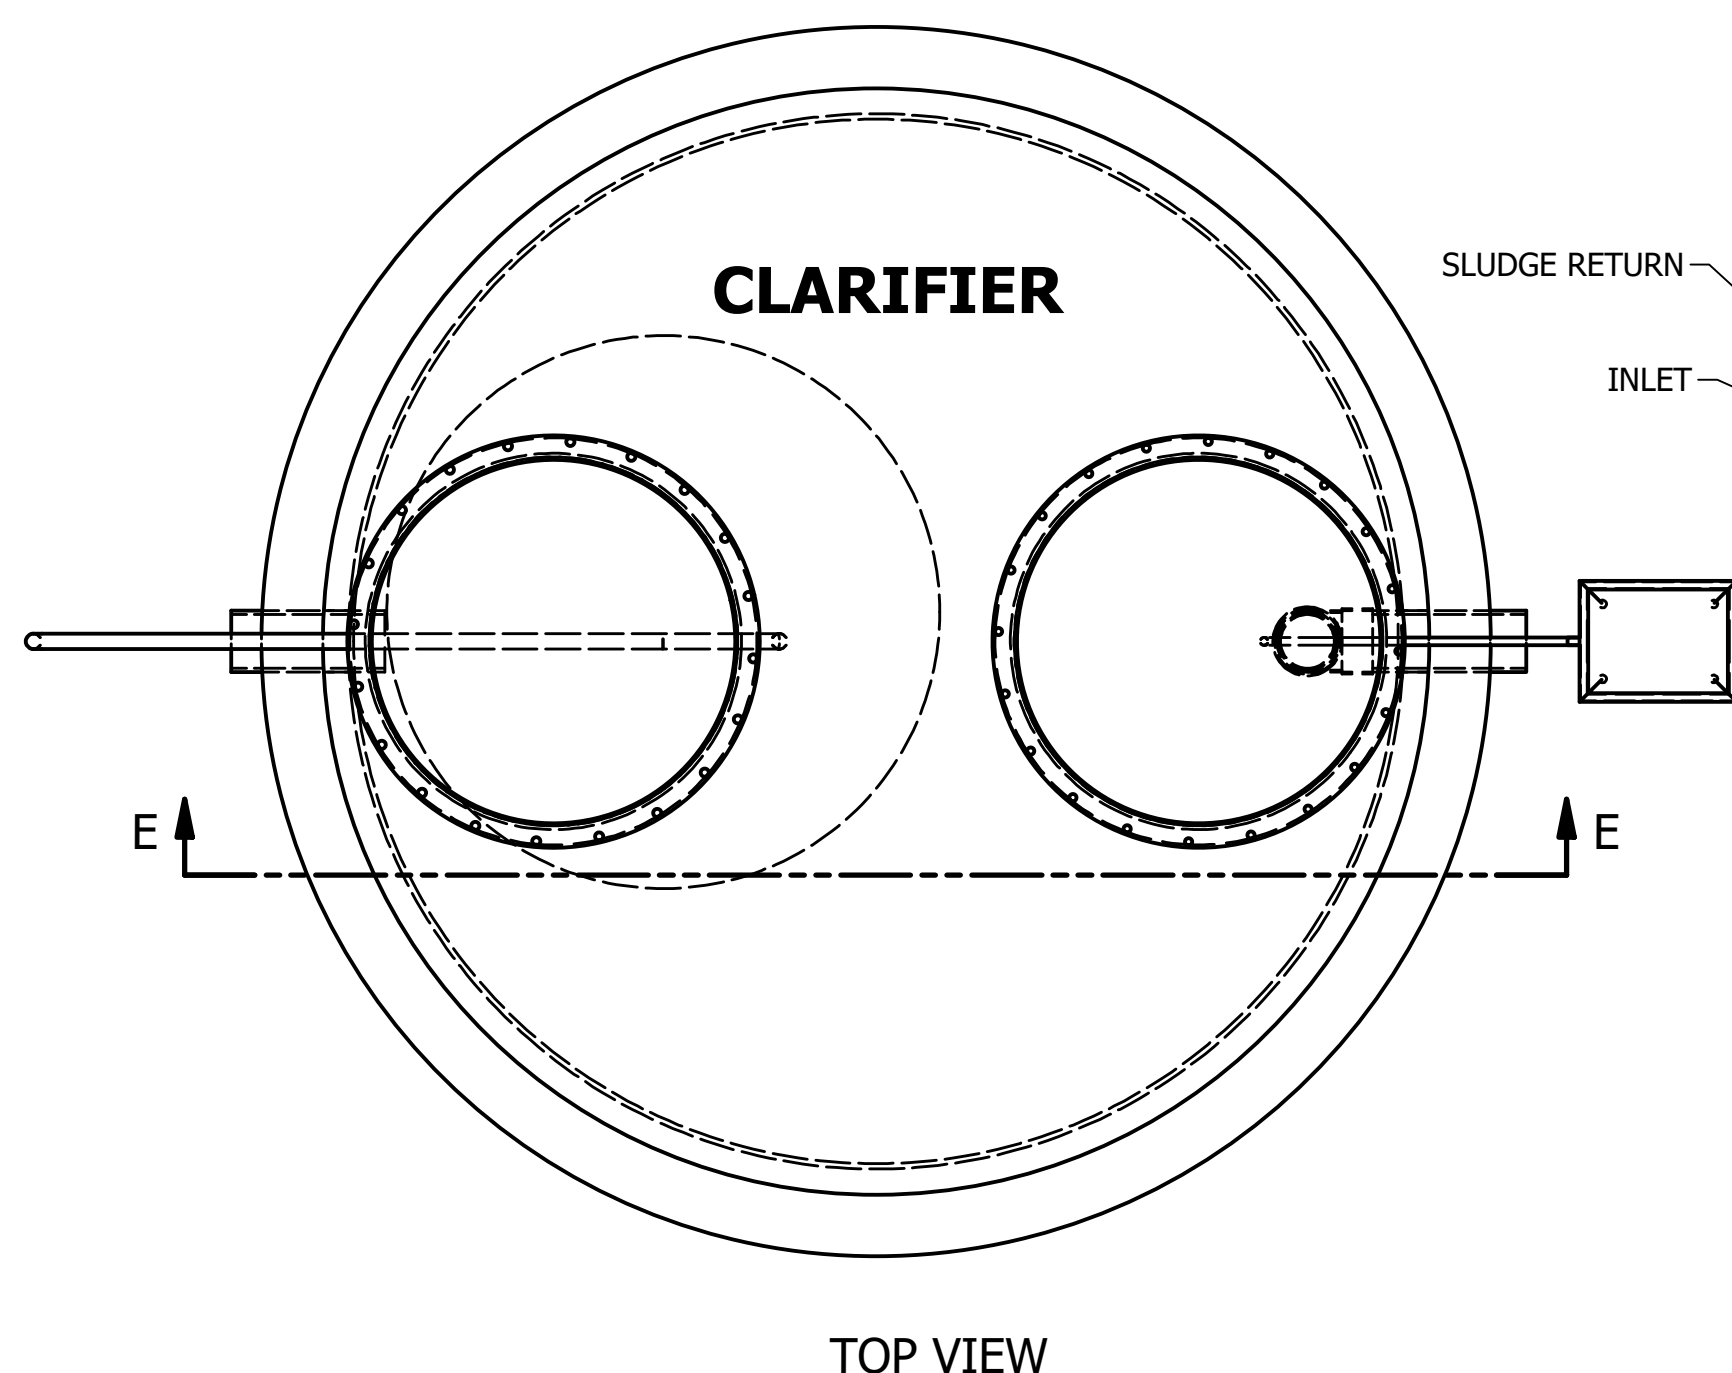
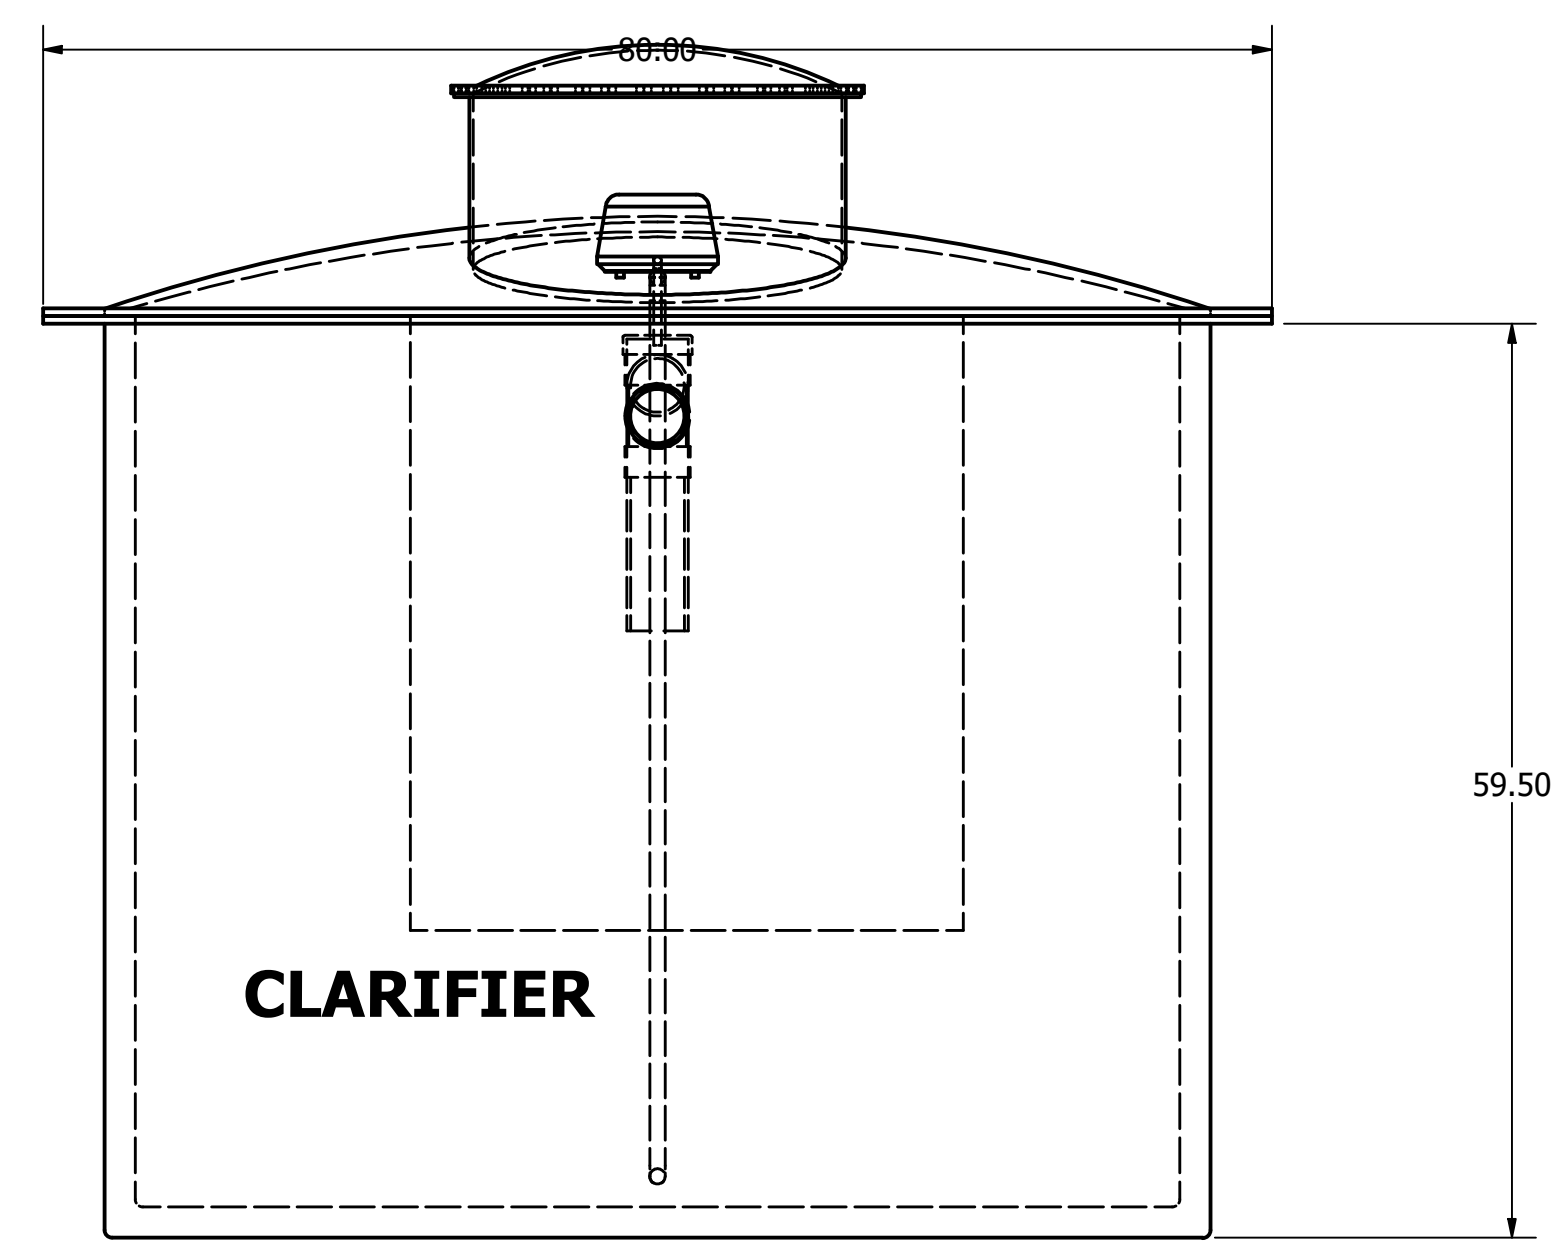
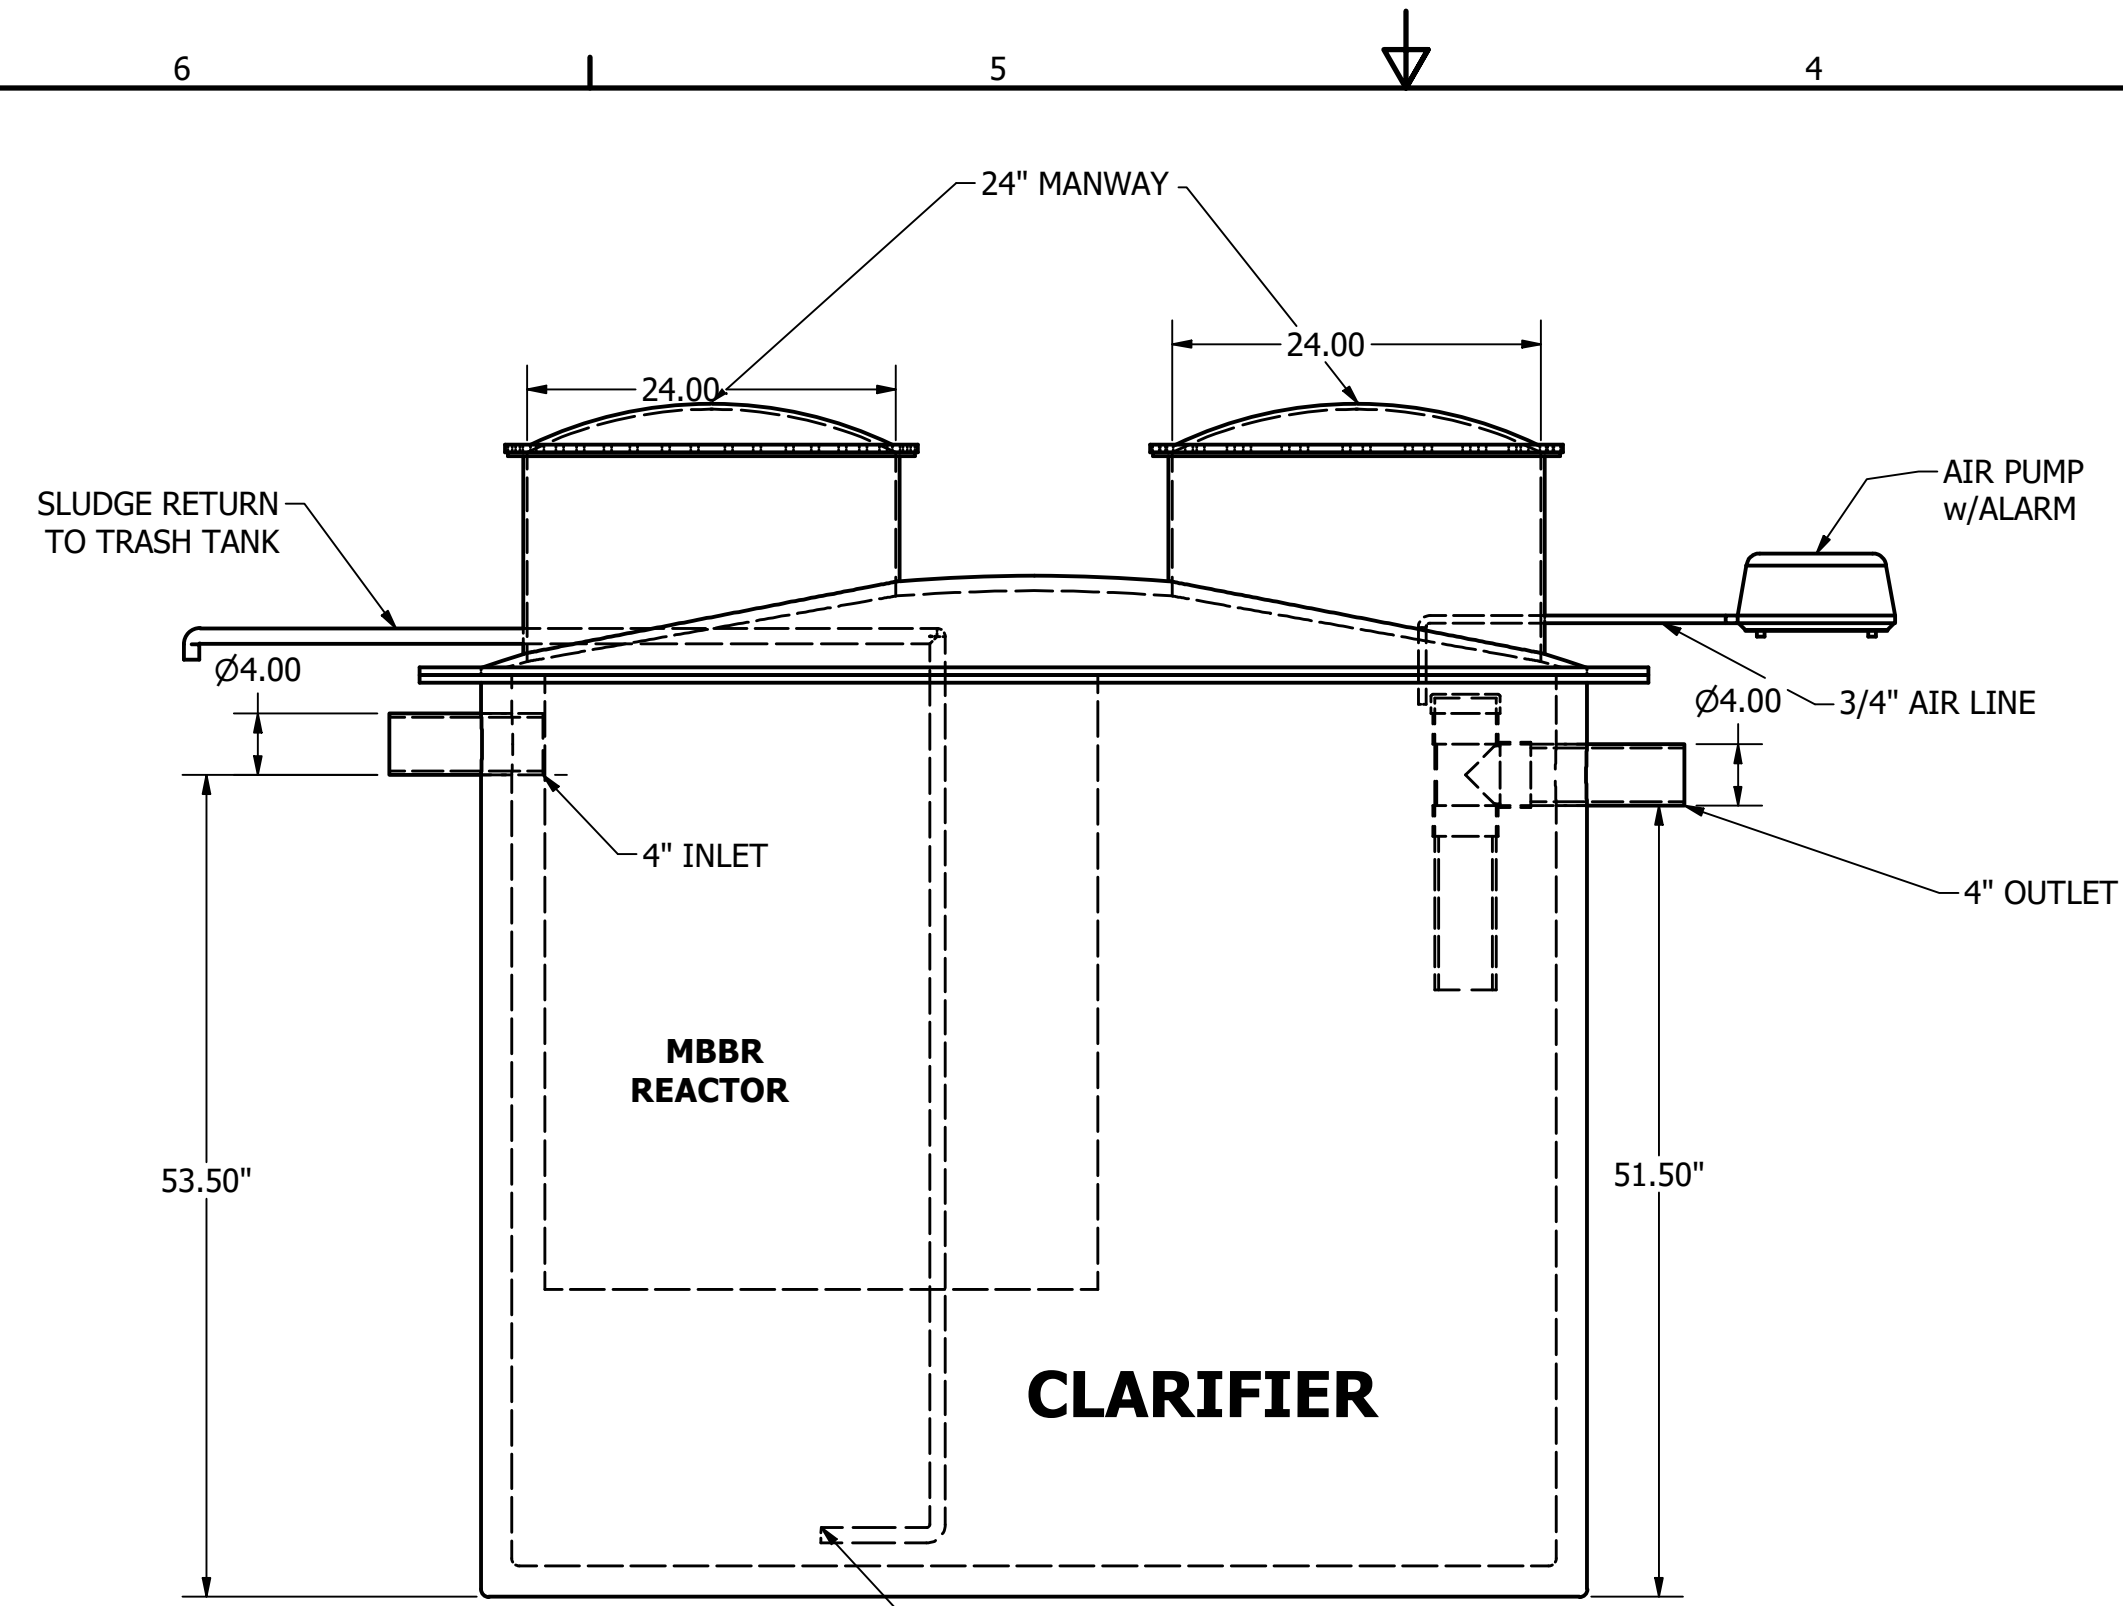


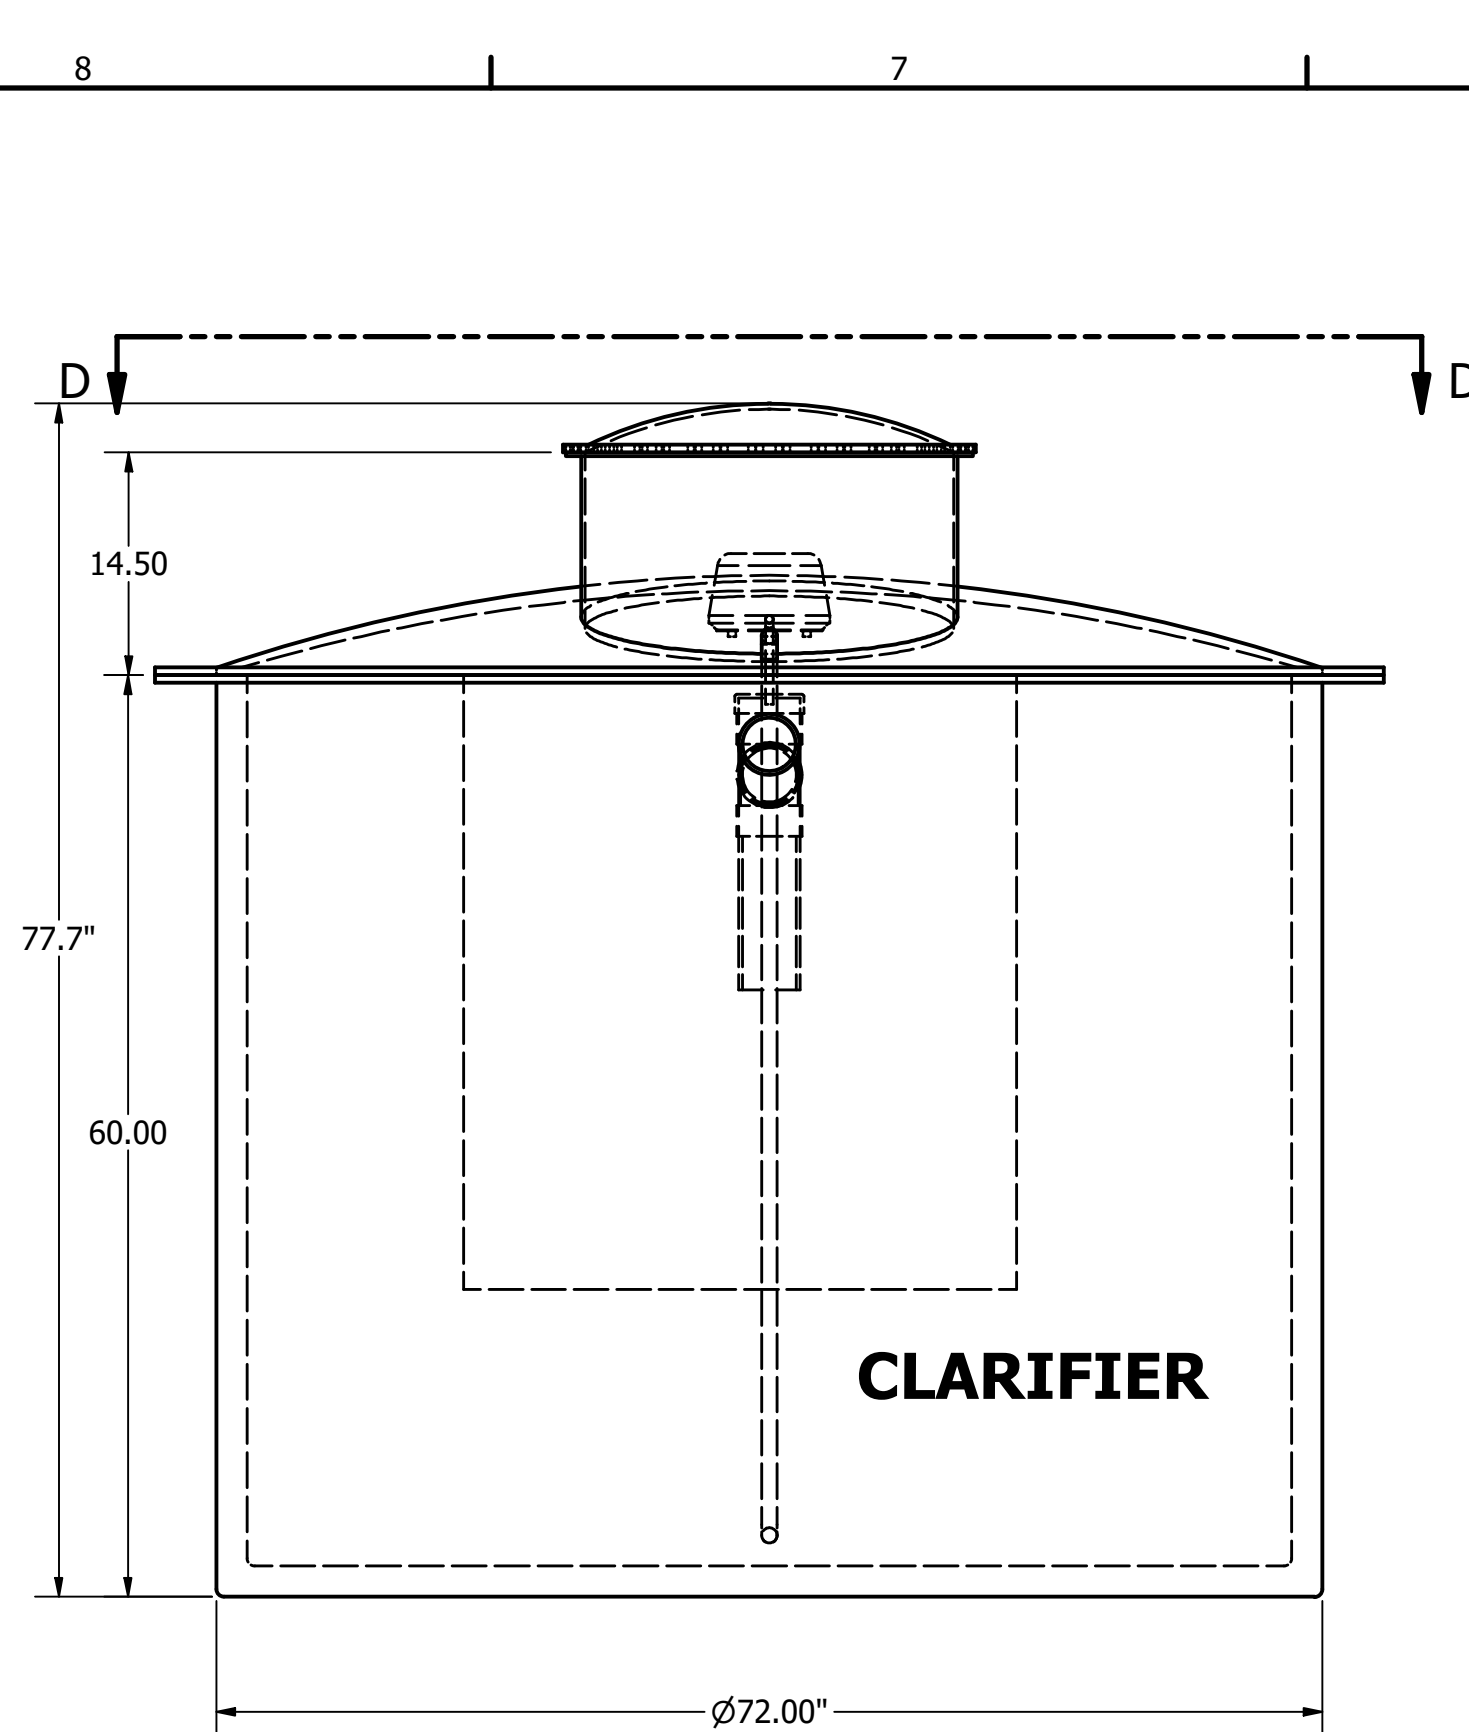

CWS-MBBR500-1-T2
500 US GAL/DAY

TYPE 3 INSTALLS WILL HAVE
UV LIGHT INSTALLED ON INLET
OF PUMP CHAMBER

DRAWN KEIR PARSONS	3/17/2021	CANADIAN WASTEWATER SOLUTIONS		
CHECKED		TITLE		
QA		CWS-MBBR500-1-T2		
MFG				
APPROVED				
		SIZE D	DWG NO CWS-MBBR500-1-T2	REV
		SCALE 0.08 : 1	SHEET 1 OF 1	